
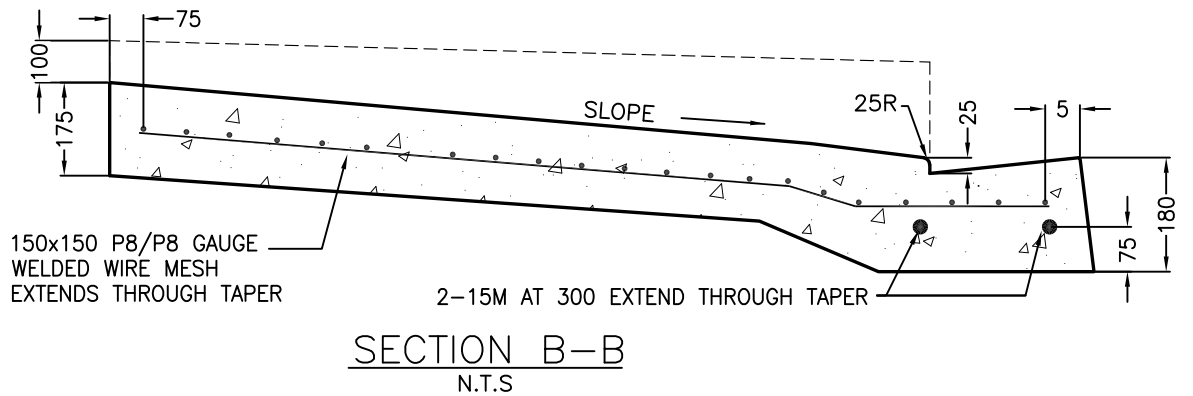
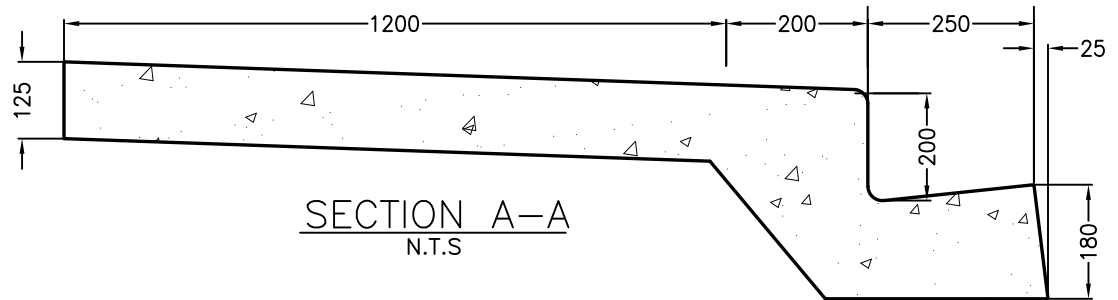


NOTES:

1. MAINTAIN THICKENED DEPTH THROUGHOUT.
2. WHEN 200mm BARRIER CURB IS SPECIFIED THE BACK OF WALK SHALL BE LOWERED 100mm FOR THE WIDTH OF CROSSING
3. ALL DIMENSIONS ARE IN MILLIMETRES
4. REINFORCING AND THICKENING NOT REQUIRED AT PRIVATE CROSSING.
5. MIN. DEPTH OF CROSSING TO BE 1.4m IF PLACED WITHOUT SIDEWALK.

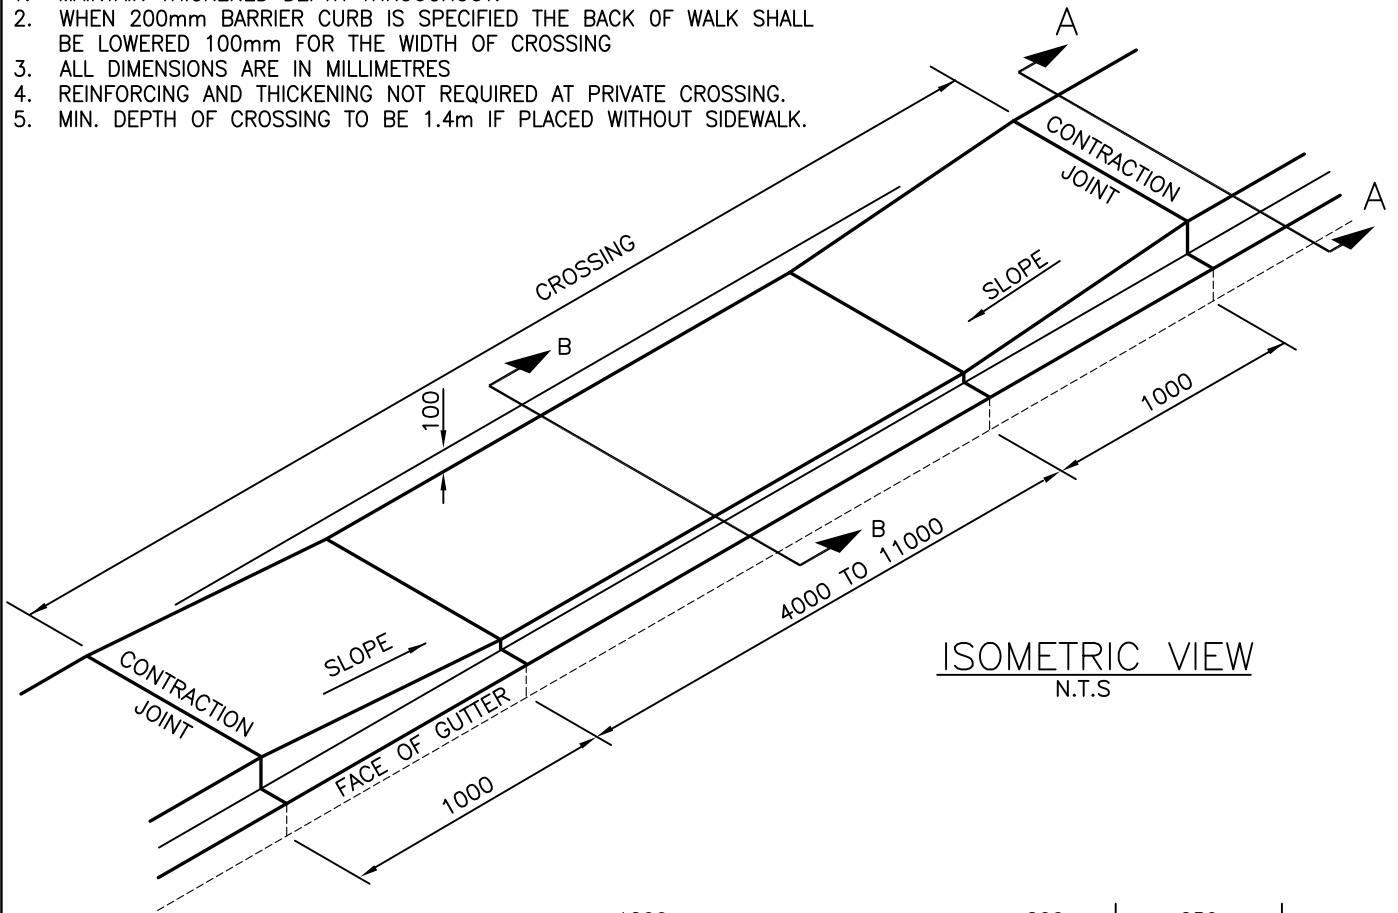

**200mm BARRIER MONOLITHIC CROSSING
DETAILS – COMMERCIAL, LANE & PRIVATE
CROSSINGS**

STD DWG

B4.2

DATE: JANUARY 2007