


**FOOTING OVER UNDISTURBED SOIL**

A discharge pipe shall be roughed in to the sump location from the discharge location at the building face.

The discharge location shall be established to ensure positive drainage away from the building and not drain onto neighbouring properties, lanes, sidewalks, boulevards or streets. Place discharge pipe to drain somewhere on owners property where water can be absorbed, such as a lawn or flower bed.

Provision for the supply of power to a sump pump is to be provided. Generally this will require a separate 15 Amp 120V circuit with 14 Ga. conductors. Sump pump to be minimum 1/3 HP submersible.

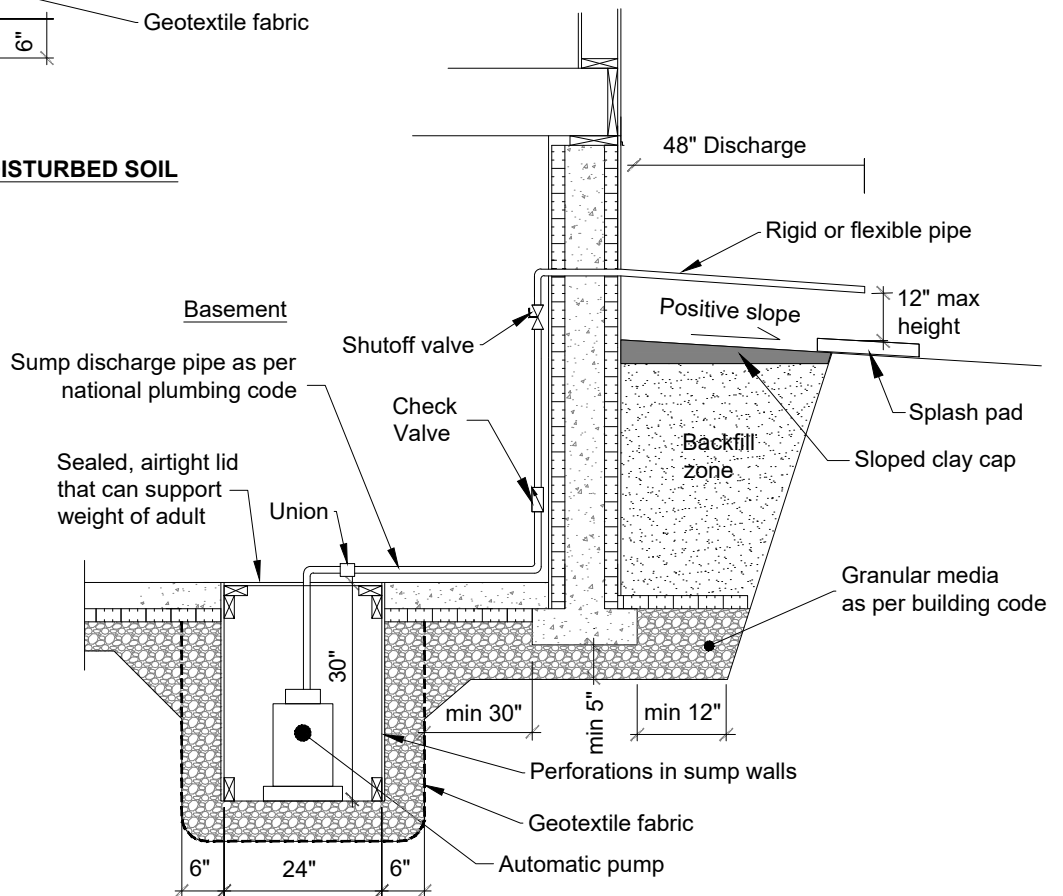

**FOOTING OVER GRANULAR DRAINAGE LAYER**

**CITY OF WHITEHORSE**

**FOUNDATION DRAINAGE  
ICF / Concrete Foundation**



SCALE:	Not to scale	DRAWN:	RC
DATE:	JUNE 2025	CHECKED:	TE
DRAWING:			
REVISION:			